CLEVELAND COUNTY WATER
WATER LINE CREEK CROSSING
DETAIL

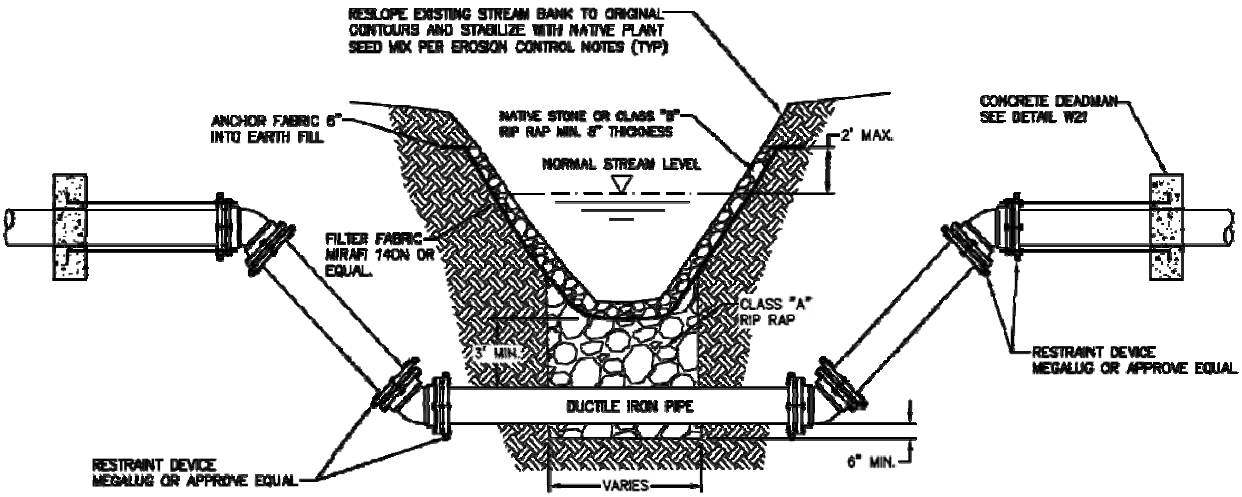

SECTION VIEW

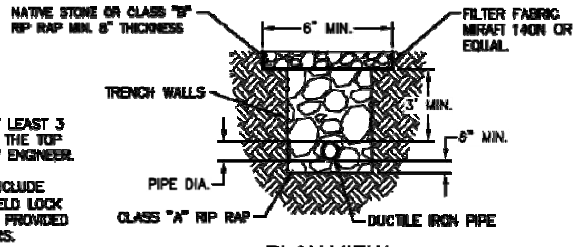

PLAN VIEW

NOTES:

1. CONTRACTOR SHALL RESTRAIN AT LEAST 3 JOINTS PAST THE LAST FITTING AT THE TOP OF THE BANK OR AS SPECIFIED BY ENGINEER.
2. APPROVED RESTRAINING DEVICES INCLUDE RETAINING GLANDS (MEGALUGS), FIELD LOCK GASKETS AND RESTRAINT SYSTEMS PROVIDED BY APPROVED PIPE MANUFACTURERS.
3. SEE OTHER DETAILS FOR ADDITIONAL EROSION CONTROL MEASURES RELATED TO CREEK CROSSING.
4. NO FERTILIZER SHALL BE USED WITHIN OF BANK

W 35

WATER LINE CREEK CROSSING

UPDATED MARCH, 2017

NOT TO SCALE